

BATTERY CAPACITY TEST REPORT

Service: Borik PLUS d.o.o. **Place:** Belgrade - SERBIA
Address: Antifasisticke Borbe 8/33 **Tel/Fax:** 011/6304-414
Client: 018 **Place:**
Address: **Tel/Fax:**

Notice:

Battery: **Vision** **Manufacturer:** CP1290 **Serial number:** DL03B7YK4
Assembling date: **Selling date:**
Cells: [g/cm3]

Comment:

Test results: *Test device: Gaus GSBCT25A12V*

Test parameters:

Test No: RealTime23 **Test date:** 5.5.2015 **Test time:** 12:28:49
Test current [A]: 15,0 **Break U/Cell [V]:** 1,70 **Test duration [h:m]:** 4h 00m

Test result: Ok **dT:** 0h 23 min **Ub:** 10,2 V **I:** -15 A **dC:** -5,643 Ah


Opseration:
 12.77V

<Comment>

Operator: _____

M.P.

Printing date: 5.5.2015 13:07

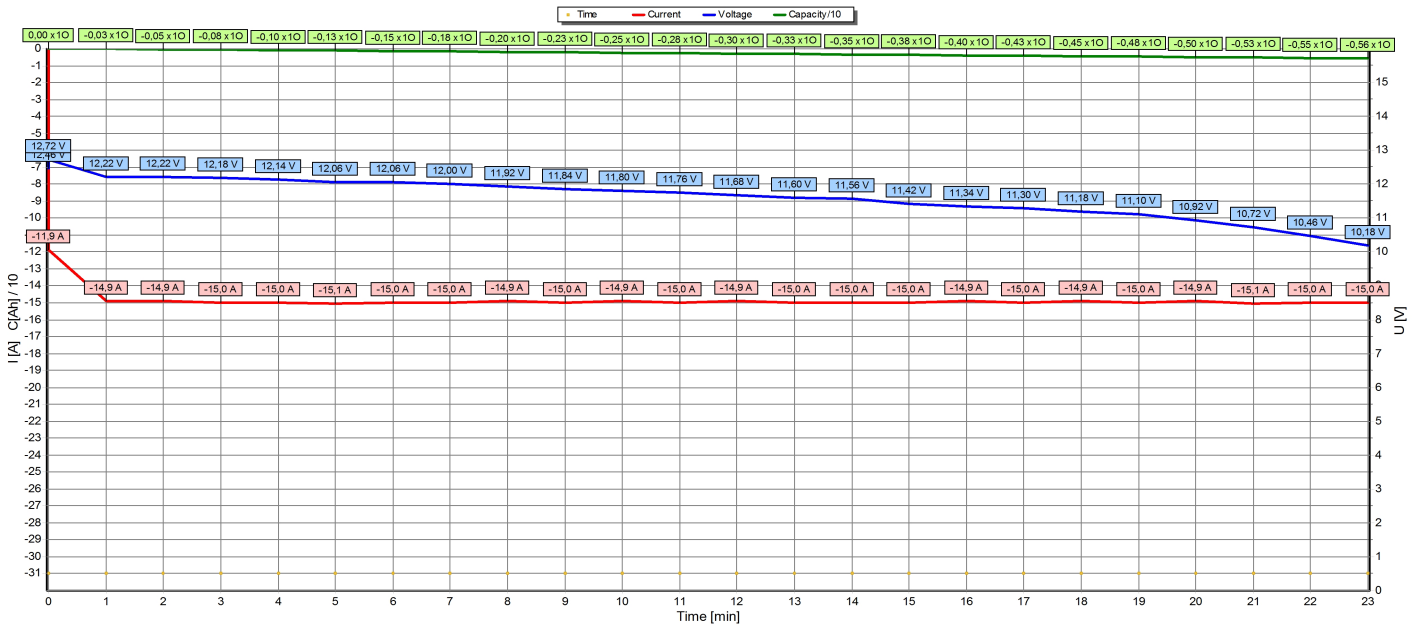

Time[h:min]	Voltage[V]	Current[A]	Capacity[Ah]	Time[h:tmin]	Voltage[V]	Current[A]	Capacity[Ah]
Before Start	12,48	0,00	0,00	0 :00	12,72	-11,95	0,00
0 :01	12,24	-14,95	-0,25	0 :02	12,24	-14,95	-0,50
0 :03	12,18	-15,00	-0,75	0 :04	12,16	-15,00	-1,00
0 :05	12,08	-15,05	-1,25	0 :06	12,06	-15,00	-1,50
0 :07	12,00	-15,00	-1,75	0 :08	11,94	-14,95	-2,00
0 :09	11,84	-15,00	-2,25	0 :10	11,82	-14,95	-2,50
0 :11	11,76	-15,00	-2,75	0 :12	11,70	-14,95	-3,00
0 :13	11,62	-15,00	-3,25	0 :14	11,58	-15,00	-3,50
0 :15	11,44	-15,00	-3,75	0 :16	11,36	-14,95	-4,00
0 :17	11,32	-15,00	-4,25	0 :18	11,20	-14,95	-4,50

Time[h:min]	Voltage[V]	Current[A]	Capacity[Ah]	Time[h:tmin]	Voltage[V]	Current[A]	Capacity[Ah]
0 :19	11,10	-15,00	-4,75	0 :20	10,94	-14,95	-5,00
0 :21	10,74	-15,05	-5,25	0 :22	10,46	-15,00	-5,50
0 :23	10,20	-15,00	-5,64				